

ZPUE S.A.

25-100 Włocławek ul. Żemkowicka 70c

ul. +88-41 51 51 000

Serial 240 +48 516 006 142

www.zpue.pl

ZPUE





Koronea group

CONTAINER TRANSFORMER STATION


Type: MZb2 10/3150

Year of manufacture: 2023 Serial number: 7-2023-009400001

HC10221-202

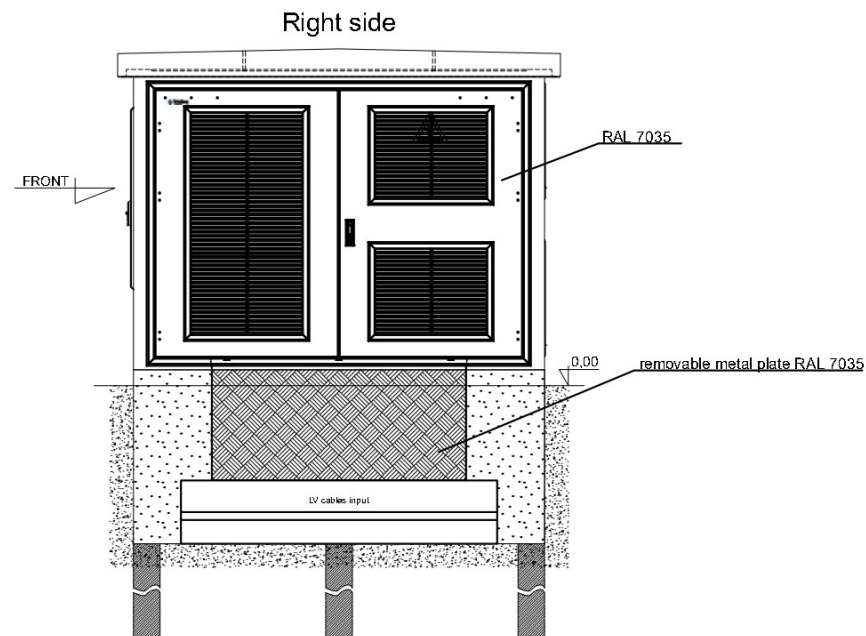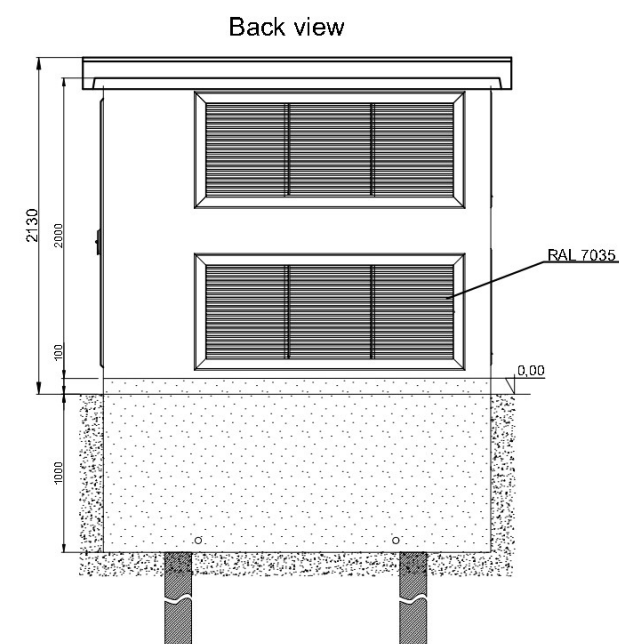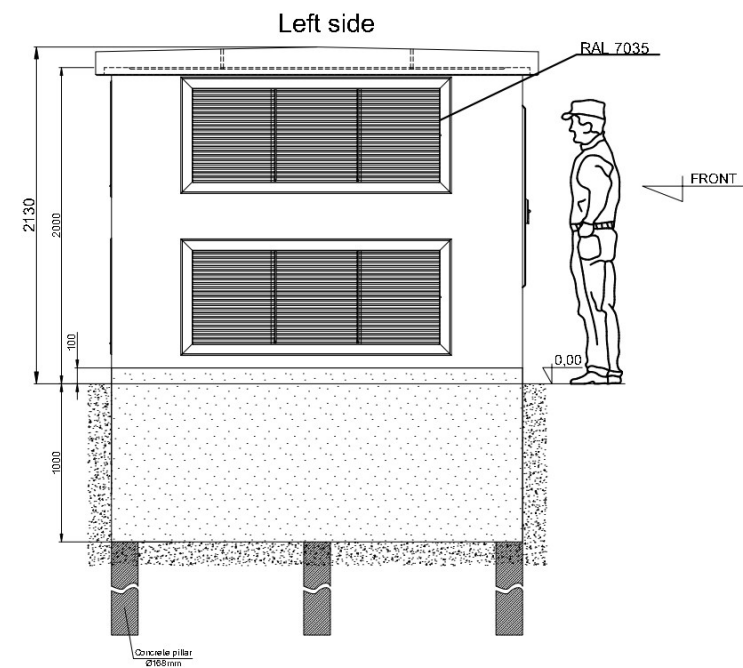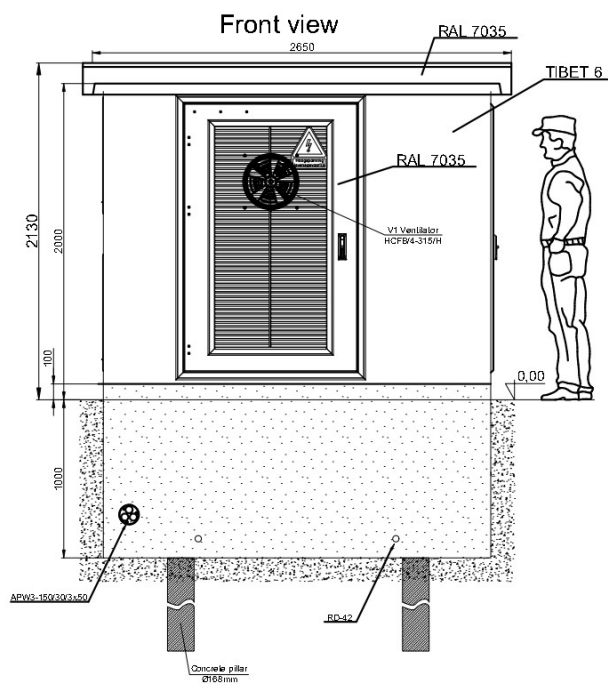


	Order	Z-2023-02354.0004	Customer:	Batenburg Energietechnik B.V.		Modification		Quantity:	1
	Commission	7-2023-00940		PowerField - Wanneperveen		Designed		Scale:	1:35
	Code number	WA7-52-000-2028	Name:	MZb2 10/3150		Checked		Page:	1/7
	Drawing number	10000229589/00				Date	10.01.2024		

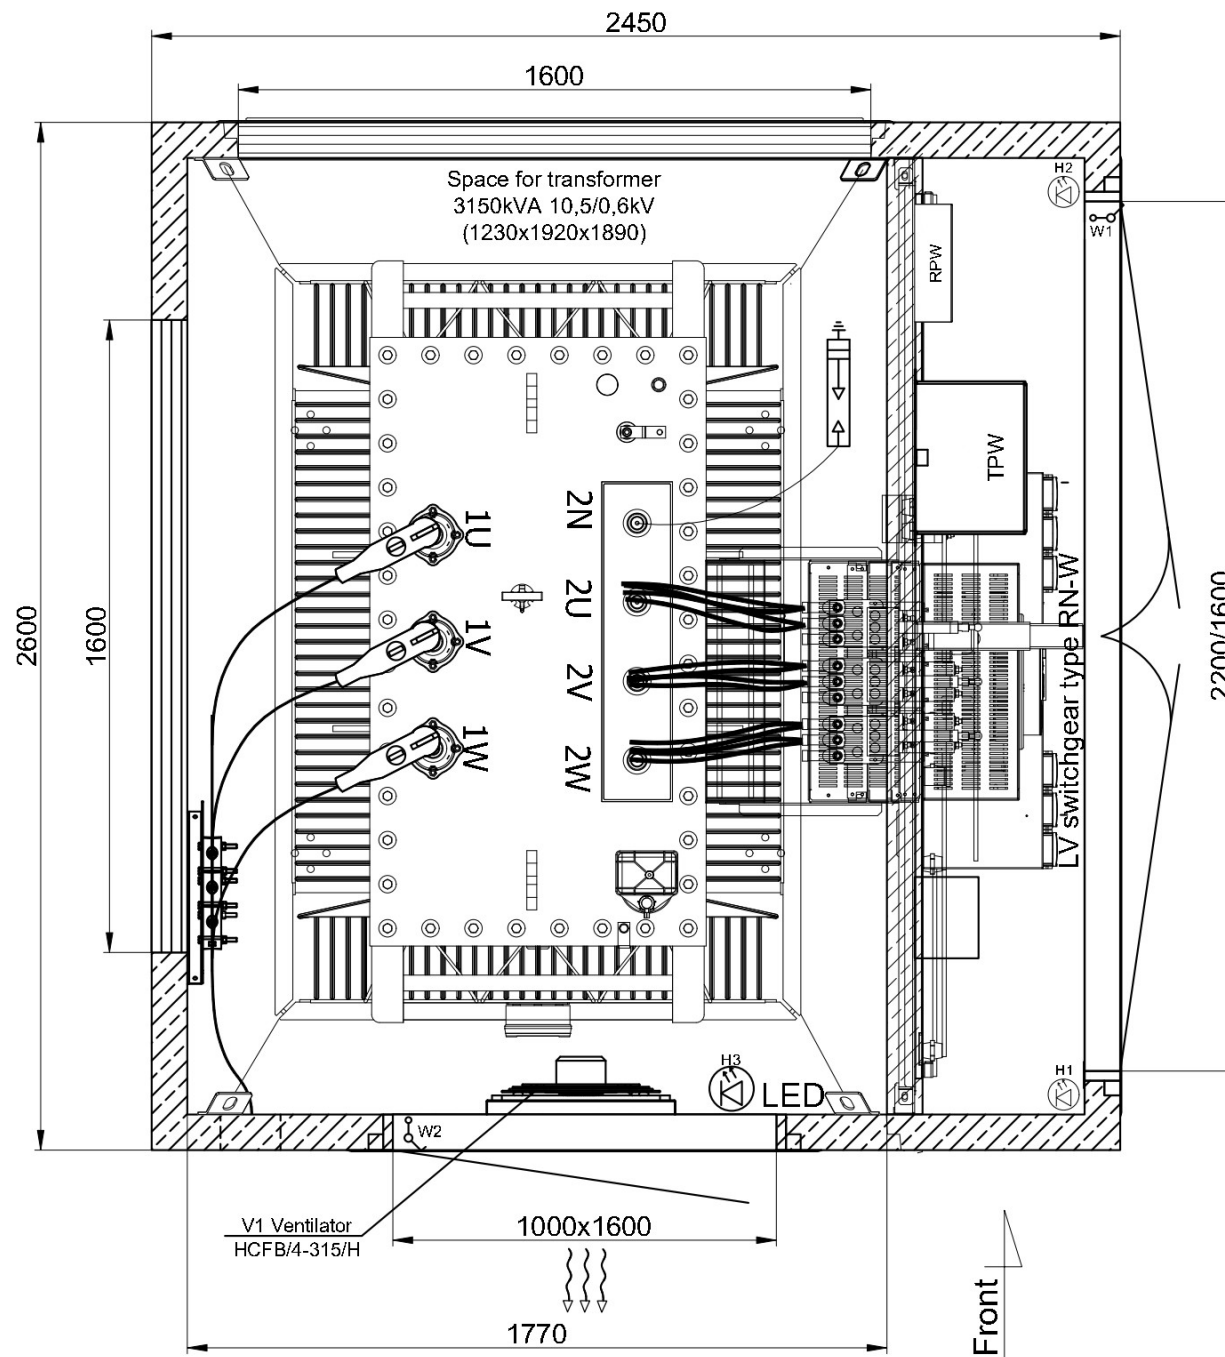

Order	Z-2023-02354.0004
Commission	7-2023-00940
Code number	WA7-52-000-2028
Drawing number	10000229589/00


Customer:	Batenburg Energietechnik B.V.
	PowerField - Wanneperveen
Name:	MZb2 10/3150

Modification		Quantity:	1
Designed		Scale:	1:35
Checked		Page:	2/7
Date	10.01.2024		

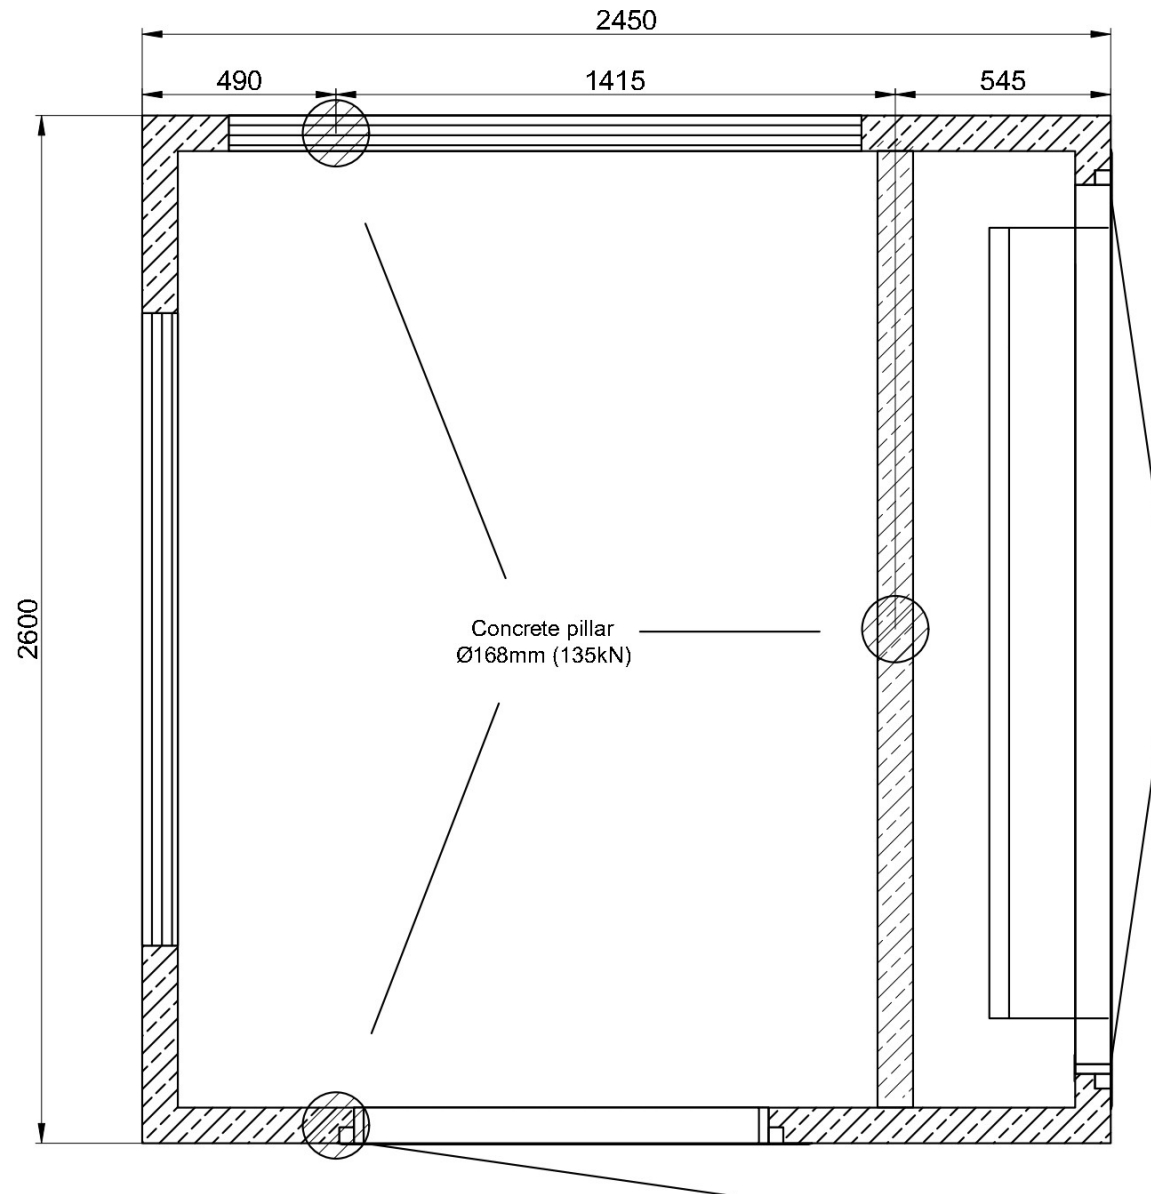



	Order	Z-2023-02354.0004	Customer:	Batenburg Energietechnik B.V.	Modification		Quantity:	1
	Commission	7-2023-00940		PowerField - Wanneperveen	Designed		Scale:	1:35
	Code number	WA7-52-000-2028	Name:	MZb2 10/3150	Checked		Page:	4/7
	Drawing number	10000229589/00			Date	10.01.2024		

Electrical diagram

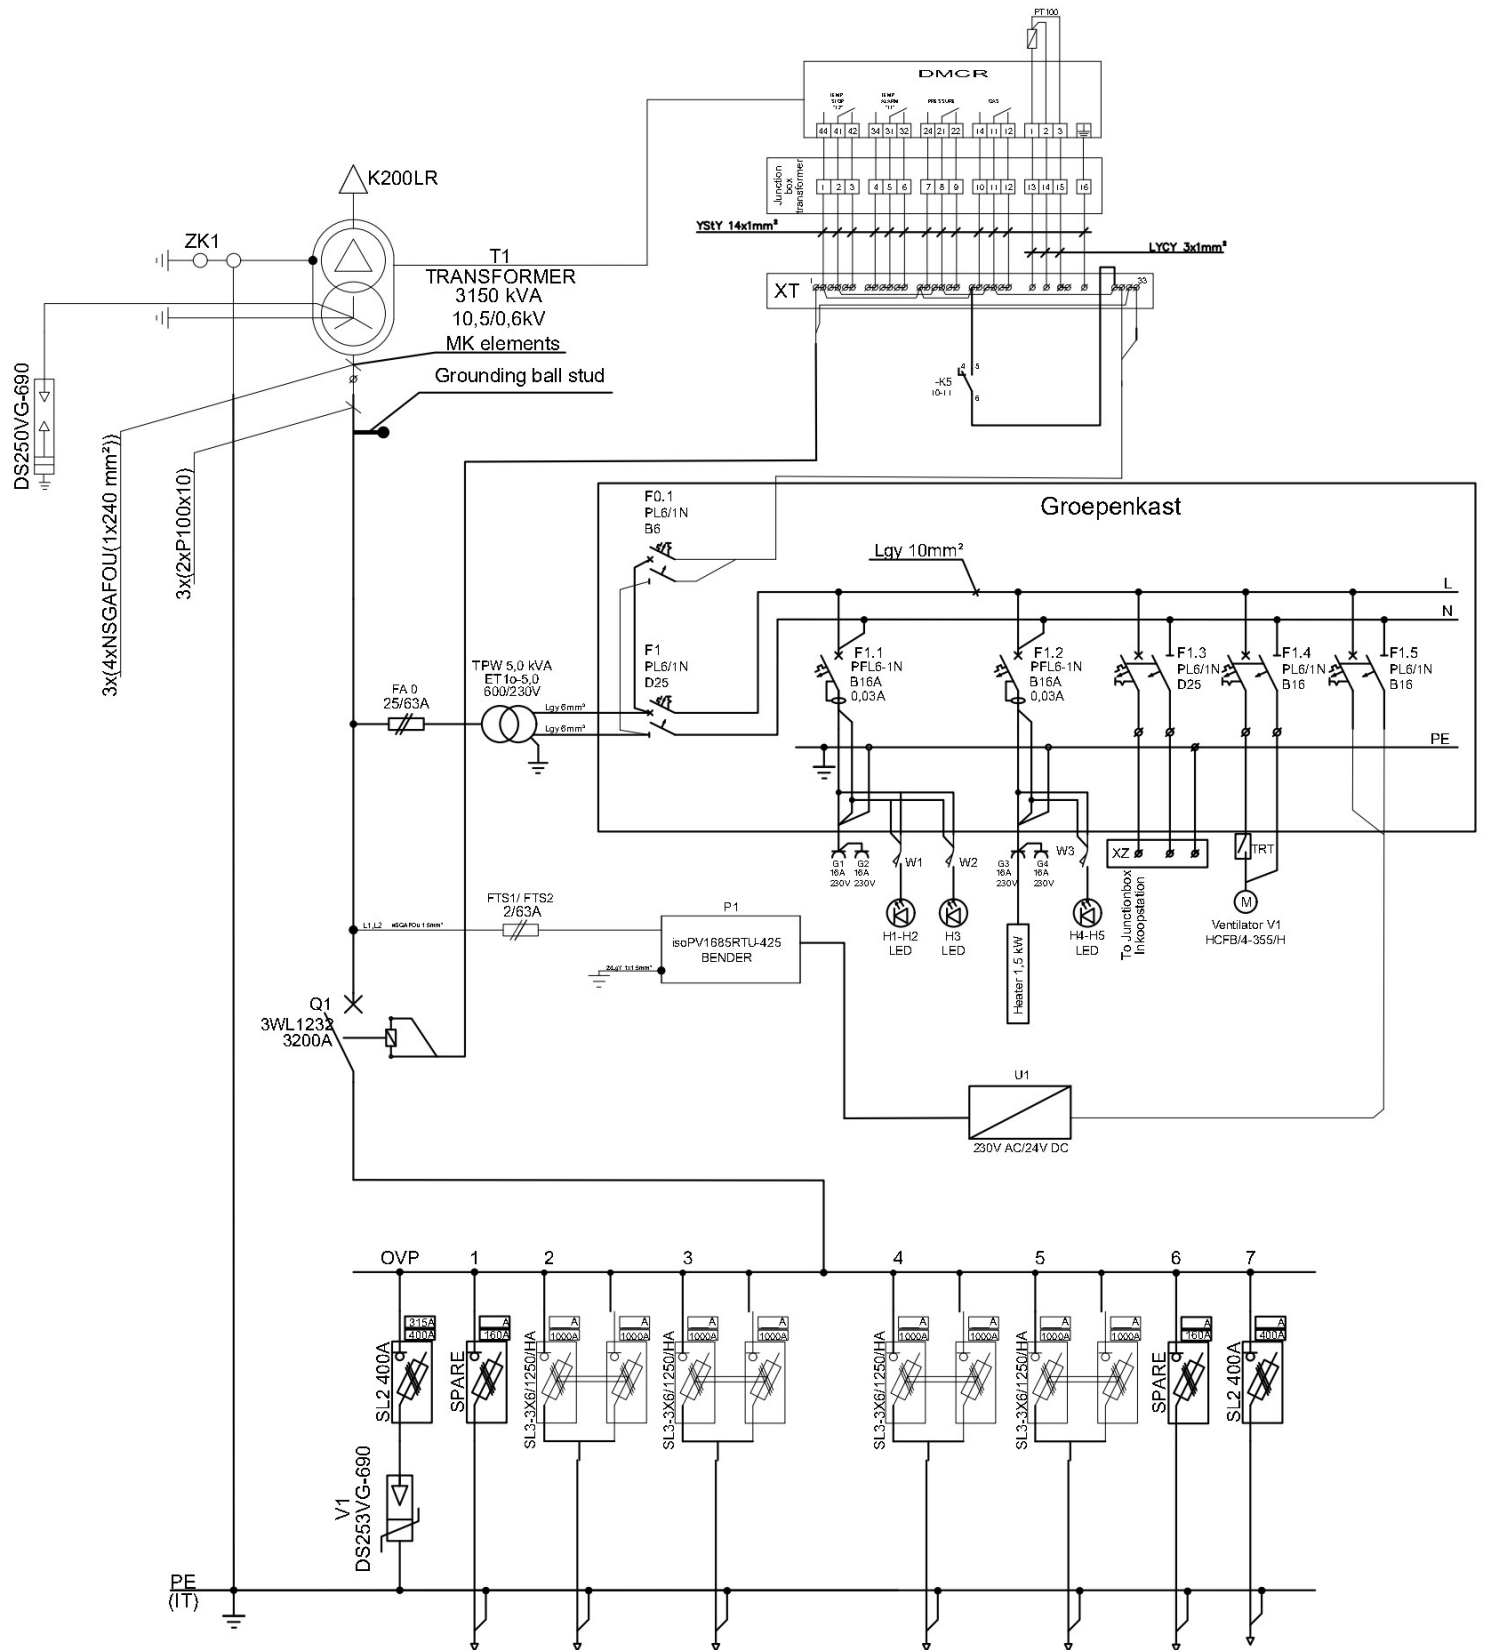

ZPUE S.A.
29-100 Włoszczowa, ul. Jędrzejowska 79c
tel. +48 41 38 81 000
Serwis 24h +48 506 005 142
www.zpue.pl

LOW VOLTAGE SWITCHGEAR				
Type	RN-W			
Year of manufacture	2023	Serial number	3-2023-100320001	
	U _n	600 V	I _n	3200 A
	U _i	1000 V	I _{cs}	55 kA
	f _n	50 Hz	I _k	121 kA
	I_{sc} - short-circuit current without effect of fault duration I_{pk} - peak short-circuit current without effect of fault duration			
IEC 61439-1				

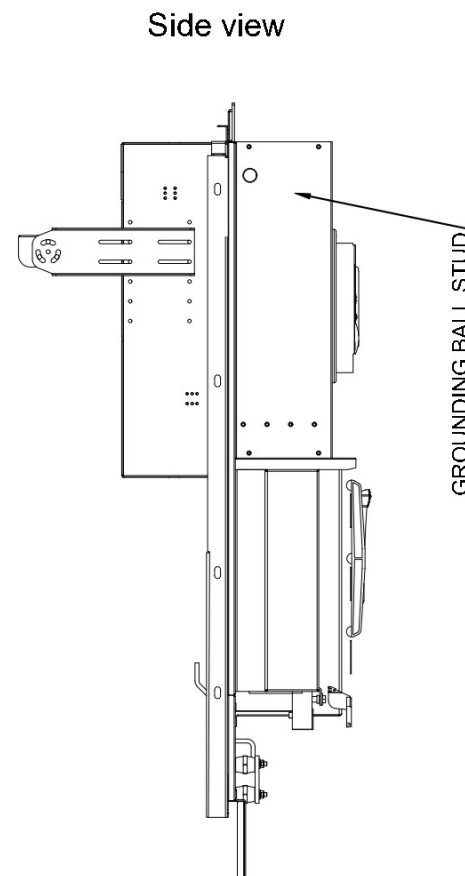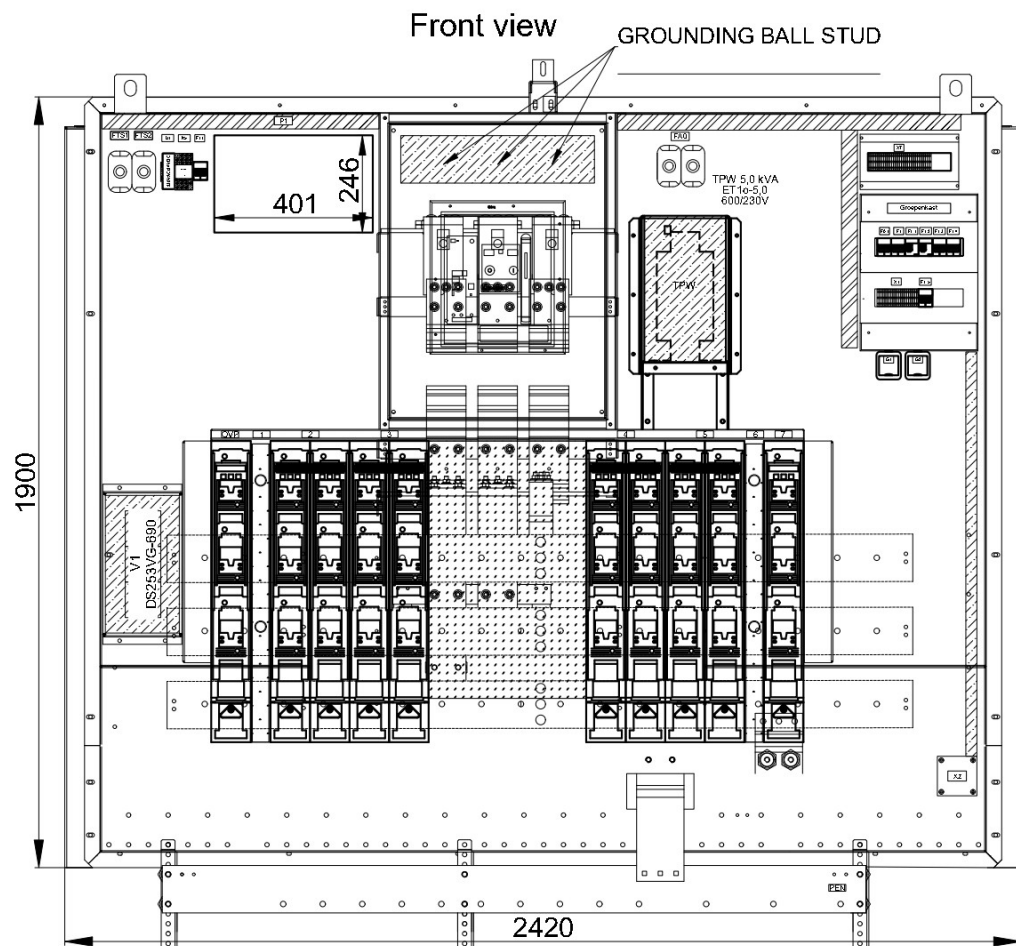

	Order	Z-2023-02354.0004	Customer:	Batenburg Energietechnik B.V.		Modification		Quantity:	1
	Commission	3-2023-10032		PowerField - Wanneperveen		Designed		Scale:	1:35
	Code number	WB0-00-000-0047	Name:	LV Switchgear type RN-W		Checked		Page:	6/7
	Drawing number	10000229589/00		MZb2 10/3150		Date	10.01.2024		

